



FNAME: CP1377-B-2

REVDATE: 0419

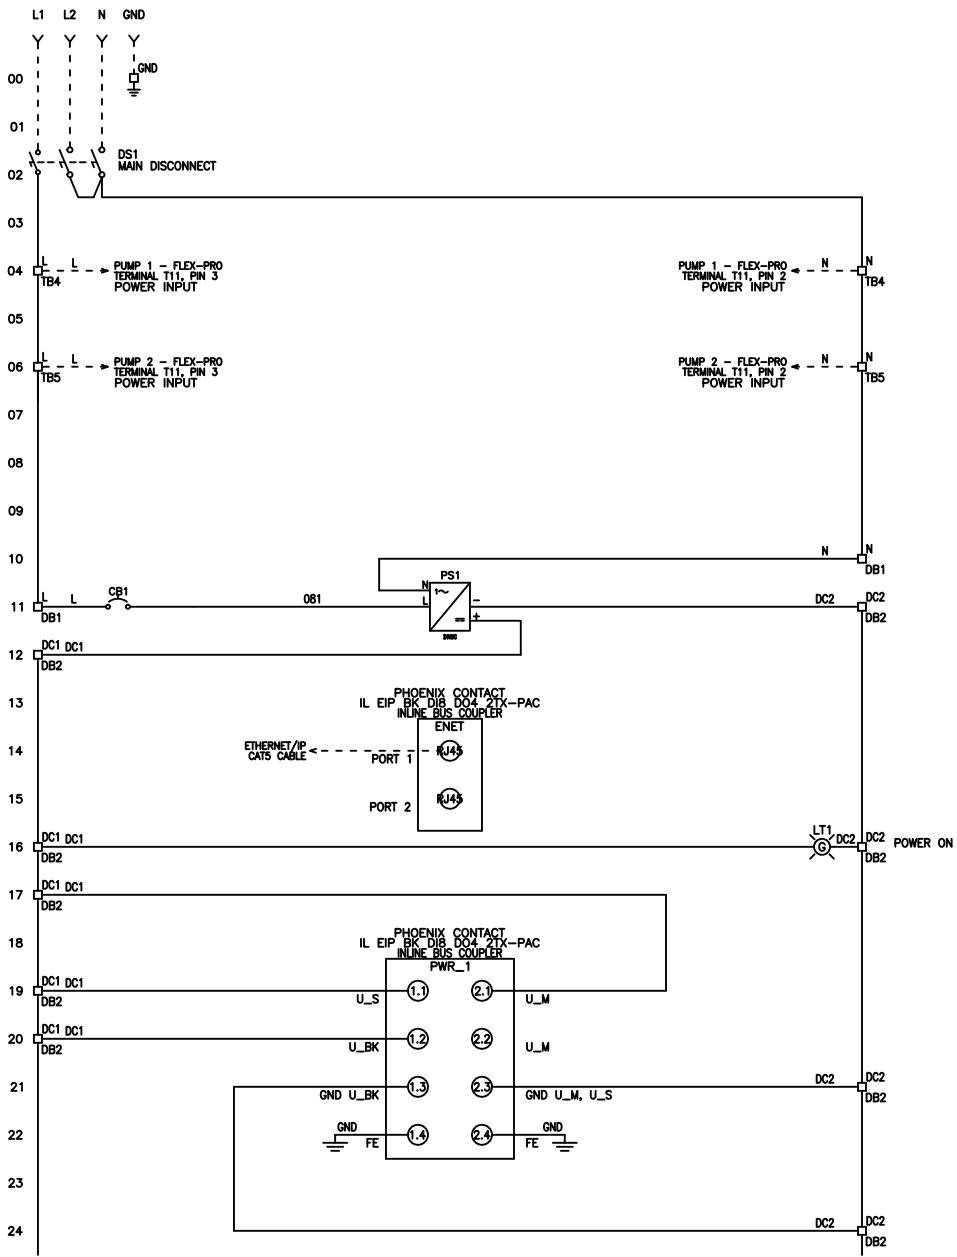


----- DASHED LINE INDICATES FIELD WIRING.

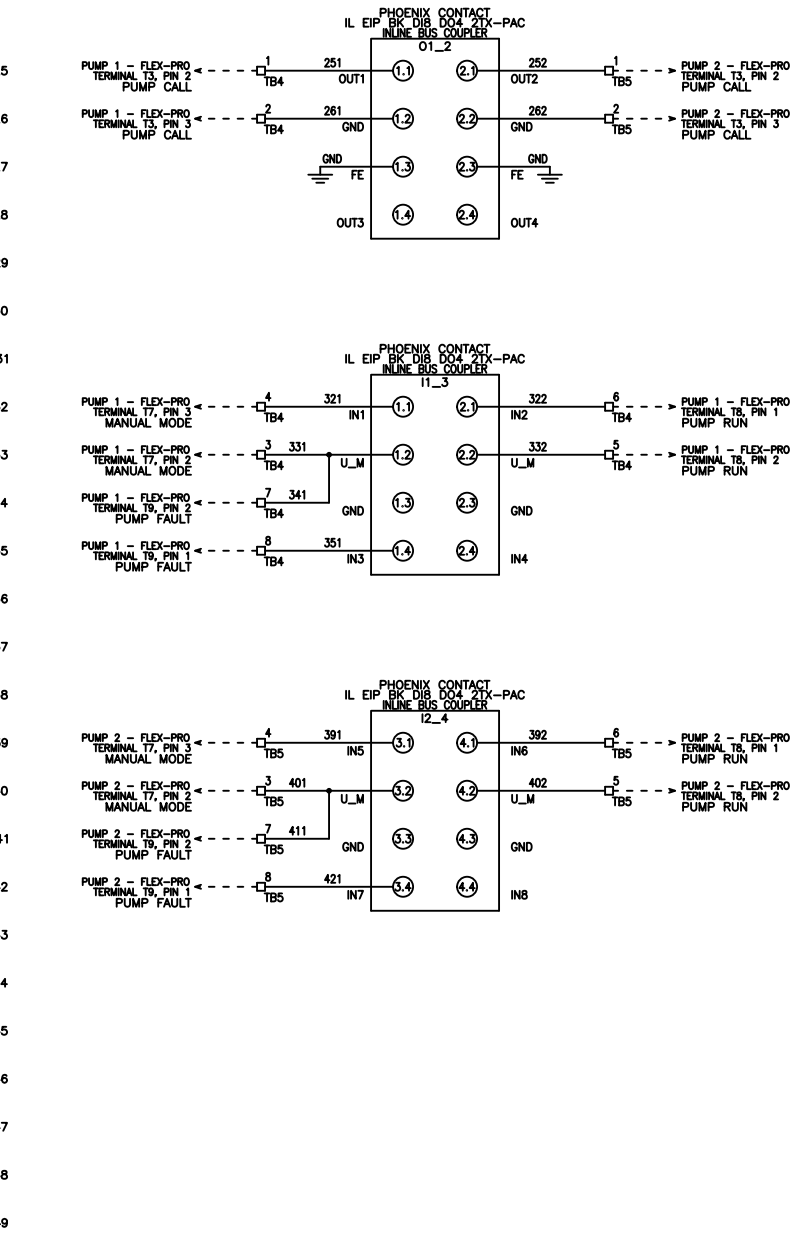



USE COPPER CONDUCTORS ONLY.
TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).
BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE INSTALLER: MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.
VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	REMOVED TB1	2/05/19	
	B	UPDATED WIRING	2/19/19	
	C	UPDATED FIELD WIRING CONNECTION LABELS AND SUPPLY VOLTAGE	3/12/19	
	D	REVISED FELX-PRO T7 WIRING & LABEL	4/17/19	

DRAWN BY: AO		DATE: 11/29/18			
APPROVED BY:		DATE:			
THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.				TITLE:	
				CP1377-B-2 DUPLEX CONTROL SCHEMATIC	
				SIZE B	DWG NO. 760
SCALE NONE				SHEET 1 OF 2	

FNAME: CP1377-B-2

REVDATE: 0419



----- DASHED LINE INDICATES
FIELD WIRING.

USE COPPER CONDUCTORS ONLY.




TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).


BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE
INSTALLER: MUST BE SIZED ACCORDING TO PUMP/MOTOR
MANUFACTURING SPECIFICATIONS.

VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER
INSTALLATION IS COMPLETE.

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	REMOVED TB1	2/05/19	
	B	UPDATED WIRING	2/19/19	
	C	UPDATED FIELD WIRING CONNECTION LABELS AND SUPPLY VOLTAGE	3/12/19	
	D	REVISED FELX-PRO T7 WIRING & LABEL	4/17/19	

FIELD WIRING CONNECTIONS

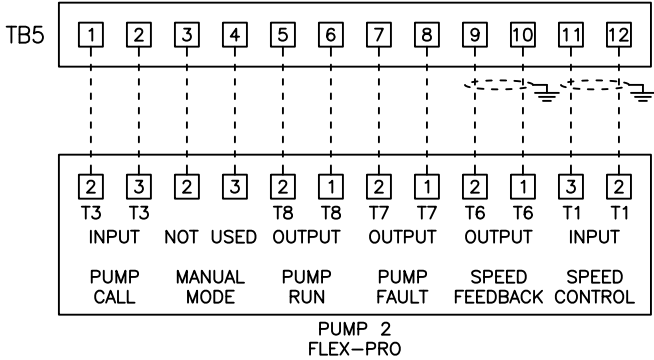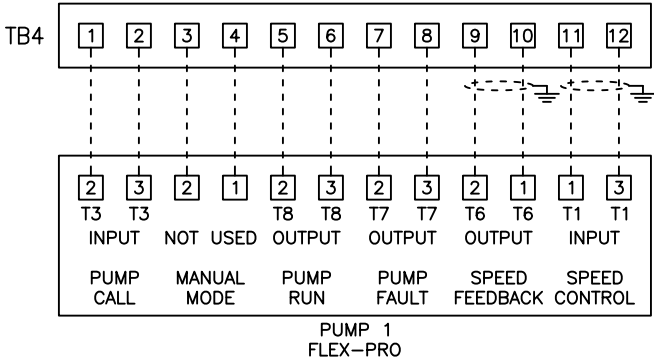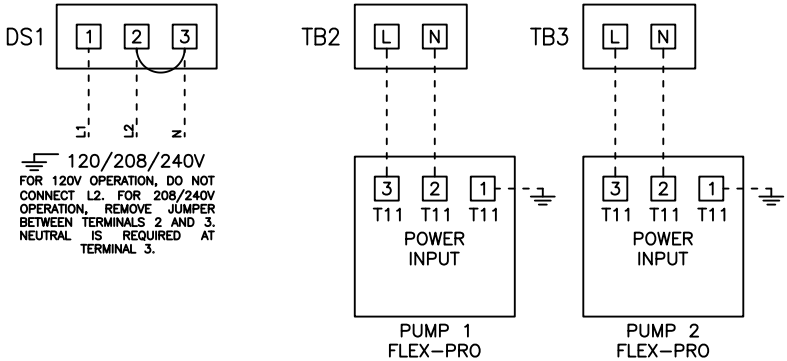

DRAWN BY:		DATE:						
AO 11/29/18		DATE:						
APPROVED BY:		DATE:		TITLE: CP1377-B-2 DUPLEX CONTROL SCHEMATIC				
THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.								
				SIZE B	DWG NO. 760	PART NO. CP1377-B-2		REV D
				SCALE NONE		SHEET 2 OF 2		