
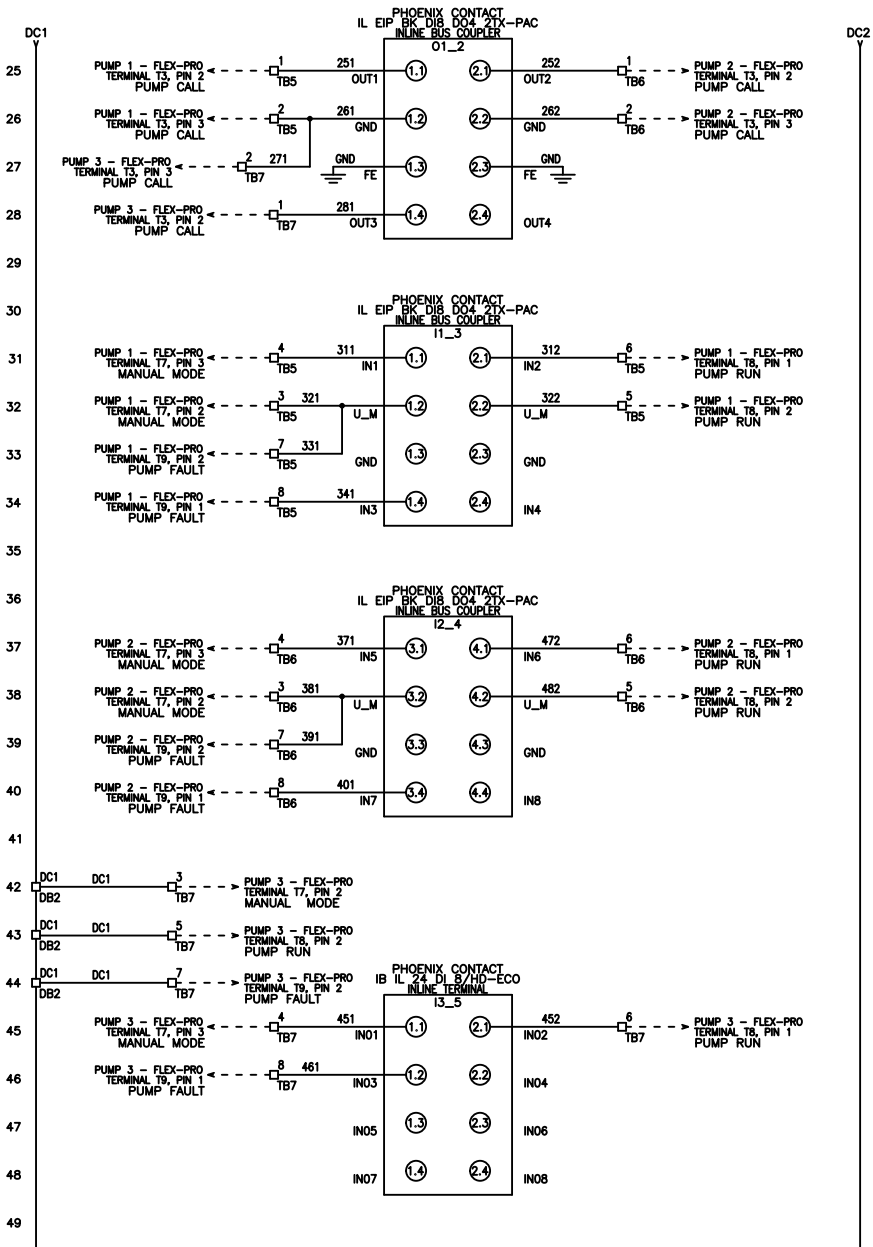


FNAME: CP1377-B-2


REVDATE: 0419

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	REMOVED TB1	2/05/19	
	B	UPDATED WIRING	2/19/19	
	C	UPDATED FIELD WIRING CONNECTION LABELS AND SUPPLY VOLTAGE	3/12/19	
	D	REVISED FELX-PRO T7 WIRING & LABEL	4/17/19	

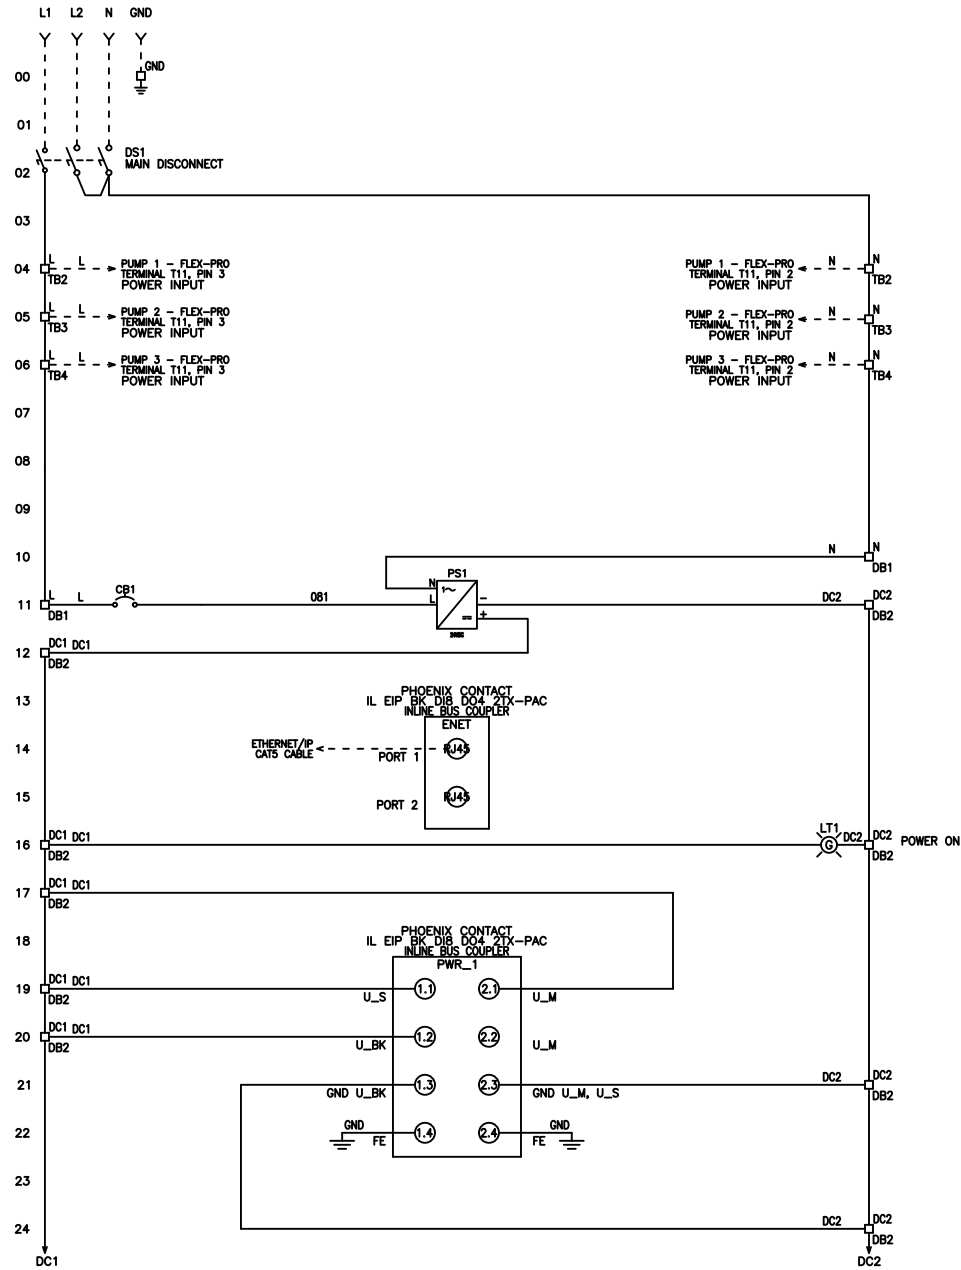



----- DASHED LINE INDICATES FIELD WIRING.

USE COPPER CONDUCTORS ONLY.
TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).
BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE INSTALLER: MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.
VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.

DRAWN BY:	DATE:				
AO 11/29/18					
APPROVED BY:	DATE:	TITLE: CP1377-B-2 TRIPLEX CONTROL SCHEMATIC			
THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.		SIZE	DWG NO.	PART NO.	REV
		B	760	CP1377-B-2	D
		SCALE	NONE		SHEET

FNAME: CP1377-B-2

REVDATE: 0419



----- DASHED LINE INDICATES
FIELD WIRING.

USE COPPER CONDUCTORS ONLY.





TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).


BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE
INSTALLER: MUST BE SIZED ACCORDING TO PUMP/MOTOR
MANUFACTURING SPECIFICATIONS.

VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER
INSTALLATION IS COMPLETE.

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	REMOVED TB1	2/05/19	
	B	UPDATED WIRING	2/19/19	
	C	UPDATED FIELD WIRING CONNECTION LABELS AND SUPPLY VOLTAGE	3/12/19	
	D	REVISED FELX-PRO T7 WIRING & LABEL	4/17/19	

FIELD WIRING CONNECTIONS

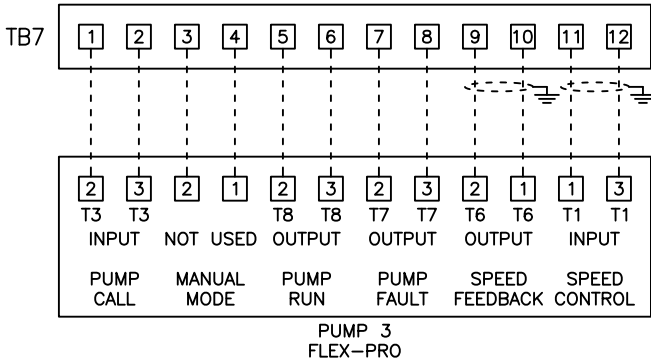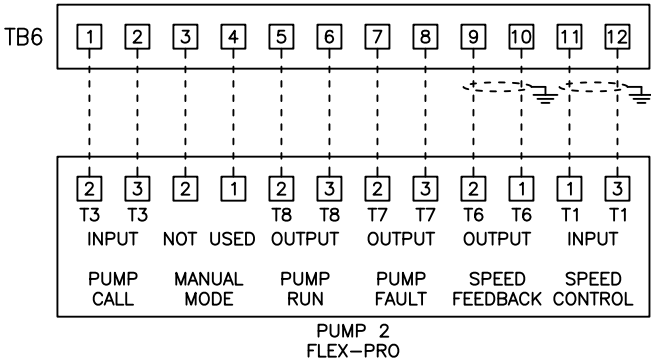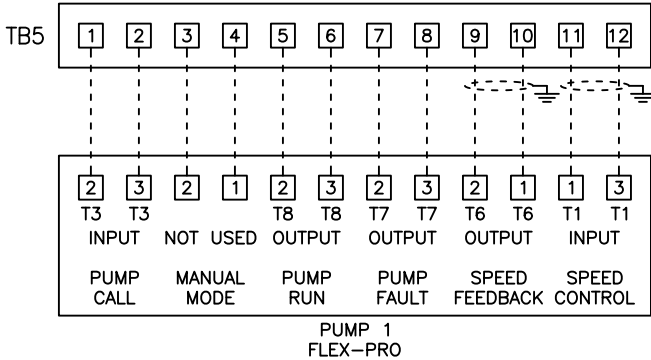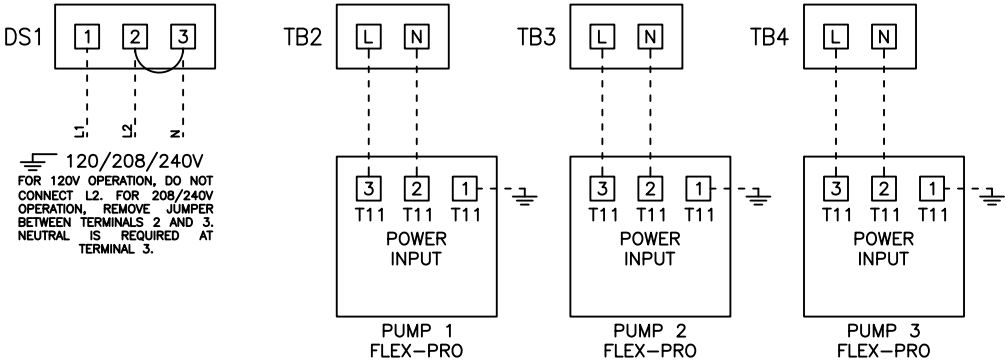

DRAWN BY:		DATE:									
AO 11/29/18		DATE:									
APPROVED BY:		DATE:		TITLE: CP1377-B-2 TRIPLEX CONTROL SCHEMATIC							
THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.				SIZE		DWG NO.		PART NO.		REV	
				B		760		CP1377-B-2		D	
				SCALE		NONE				SHEET	