
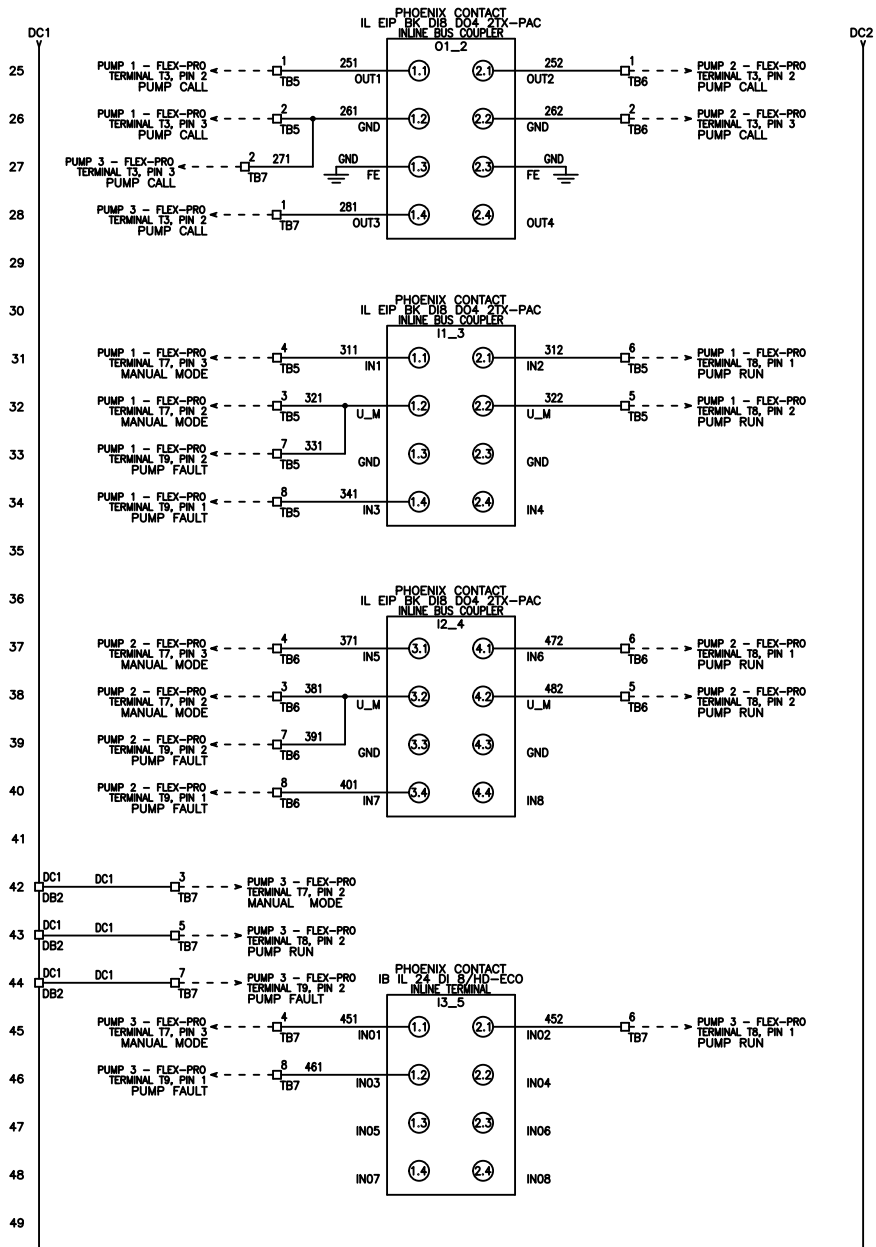


FNAME: CP1377-B

REVDATE: 0419


REVISIONS

ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	REMOVED TB1	2/05/19	
	B	UPDATED WIRING	2/19/19	
	C	UPDATED FIELD WIRING CONNECTION LABELS AND SUPPLY VOLTAGE	3/12/19	
	D	REVISED FELX-PRO T7 WIRING & LABEL	4/17/19	

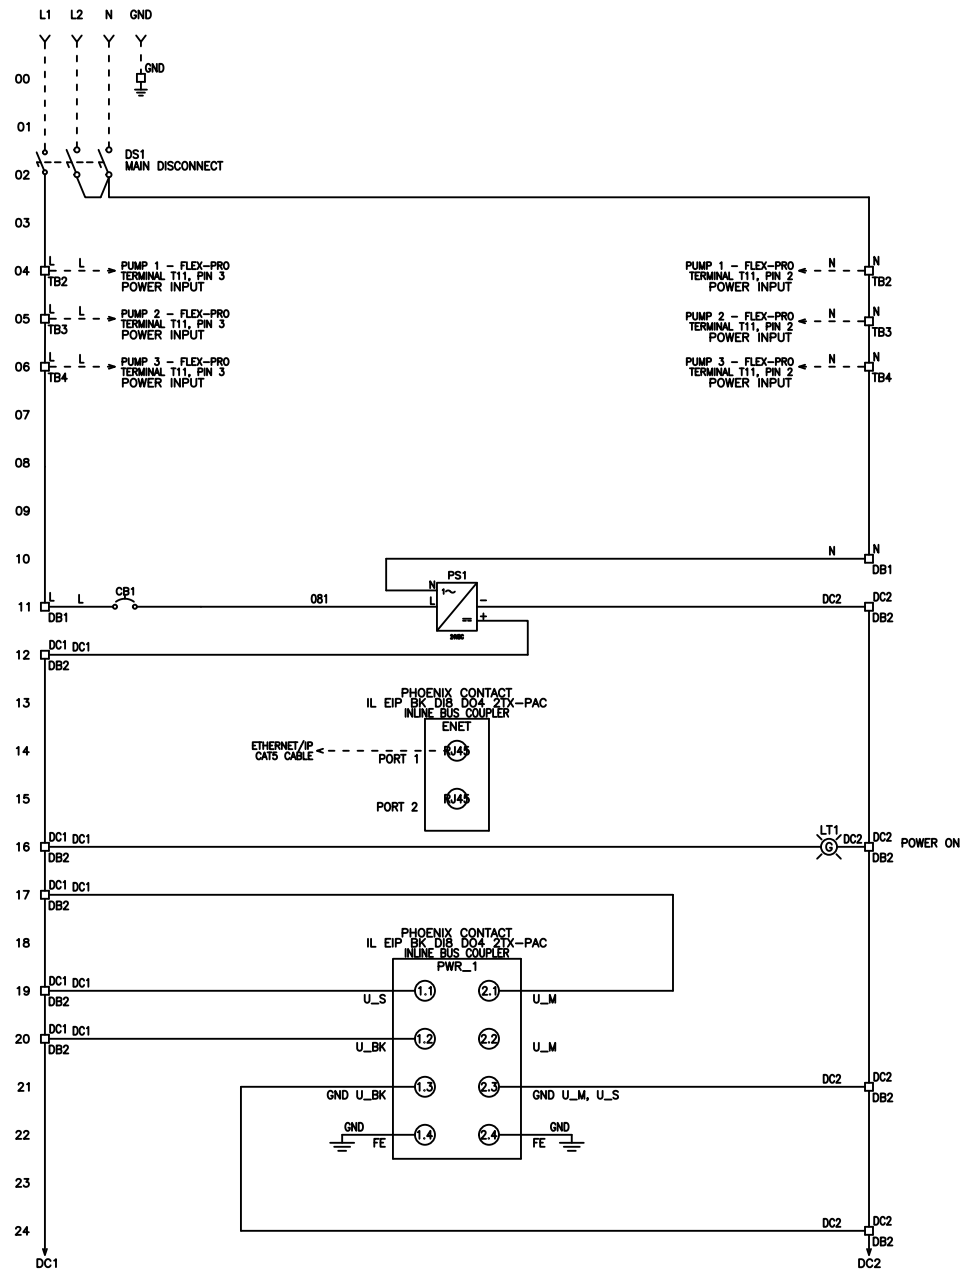



DASHED LINE INDICATES  
FIELD WIRING.

USE COPPER CONDUCTORS ONLY.  
TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).  
BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE  
INSTALLER: MUST BE SIZED ACCORDING TO PUMP/MOTOR  
MANUFACTURING SPECIFICATIONS.  
VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER  
INSTALLATION IS COMPLETE.

DRAWN BY:	DATE:				
APPROVED BY:	DATE:				
THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.		TITLE: CP1377-B TRIPLEX CONTROL SCHEMATIC			
		SIZE B	DWG NO. 760	PART NO. CP1377-B	REV D
		SCALE NONE		SHEET 1 OF 2	

FNAME: CP1377-B

REVDATE: 0419



DASHED LINE INDICATES  
FIELD WIRING.

USE COPPER CONDUCTORS ONLY.





TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).


BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE  
INSTALLER: MUST BE SIZED ACCORDING TO PUMP/MOTOR  
MANUFACTURING SPECIFICATIONS.

VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER  
INSTALLATION IS COMPLETE.

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	REMOVED TB1	2/05/19	
	B	UPDATED WIRING	2/19/19	
	C	UPDATED FIELD WIRING CONNECTION LABELS AND SUPPLY VOLTAGE	3/12/19	
	D	REVISED FELX-PRO T7 WIRING & LABEL	4/17/19	

FIELD WIRING CONNECTIONS

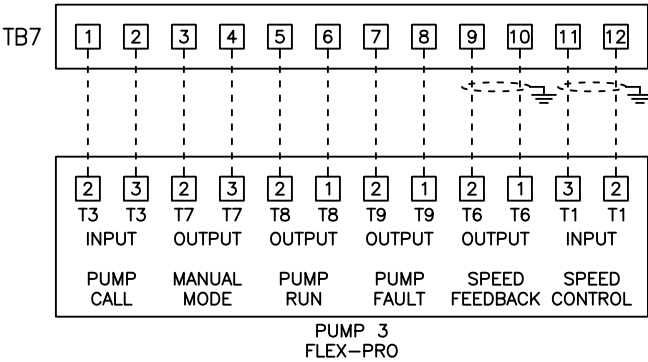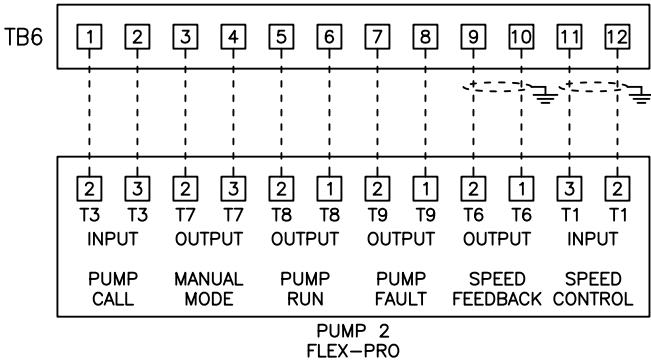

DRAWN BY: AO		DATE: 11/29/18			
APPROVED BY:		DATE:		TITLE: CP1377-B TRIPLEX CONTROL SCHEMATIC	
SIZE B	DWG NO. 760	PART NO. CP1377-B		REV D	
SCALE NONE		SHEET 2 OF 2			