
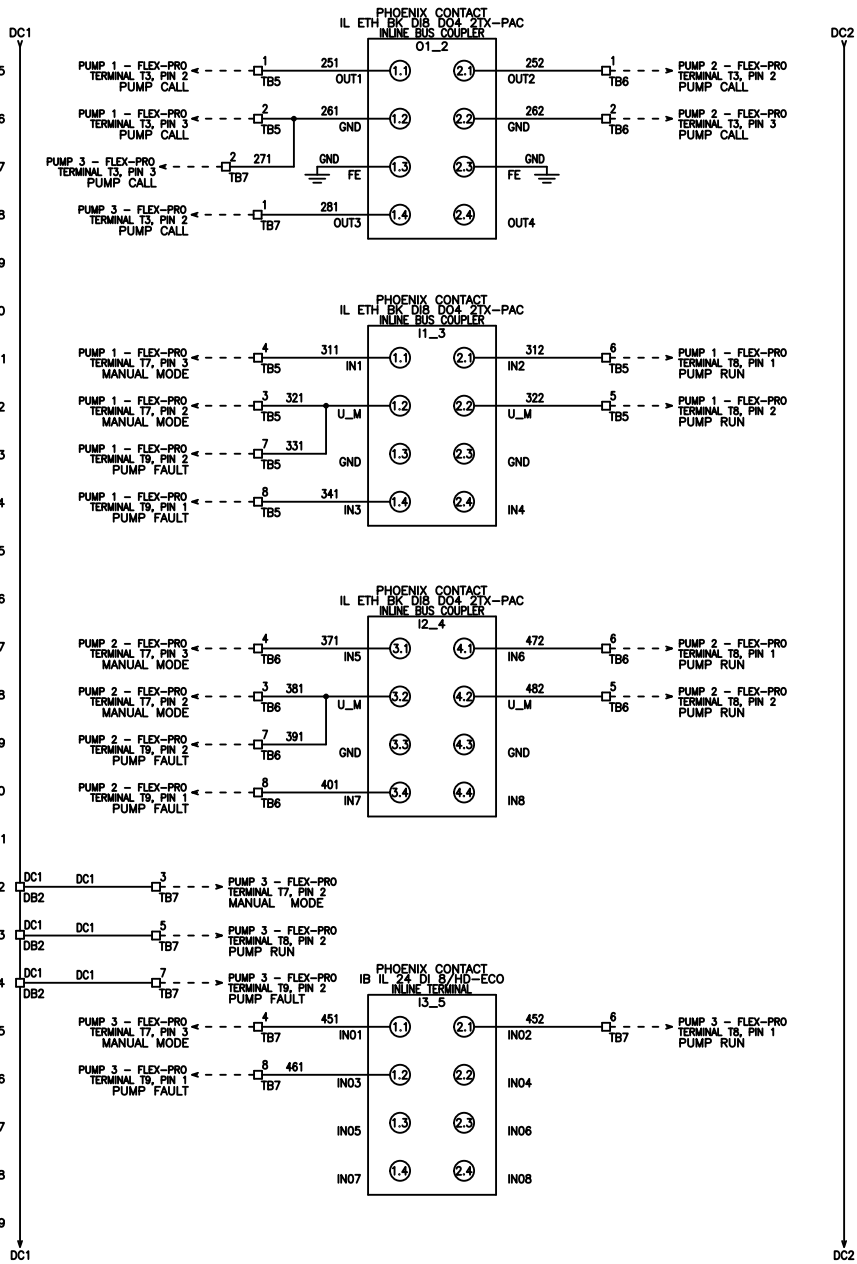


FNAME: CP1377-A

REVDATE: 0619


REVISIONS


ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	REMOVED TB1	2/05/19	
	B	UPDATED WIRING	2/19/19	
	C	UPDATED FIELD WIRING CONNECTION LABELS AND SUPPLY VOLTAGE	3/12/19	
	D	REVISED FELX-PRO T7 WIRING & LABEL	4/17/19	
	E	ADDED GW1	6/27/19	

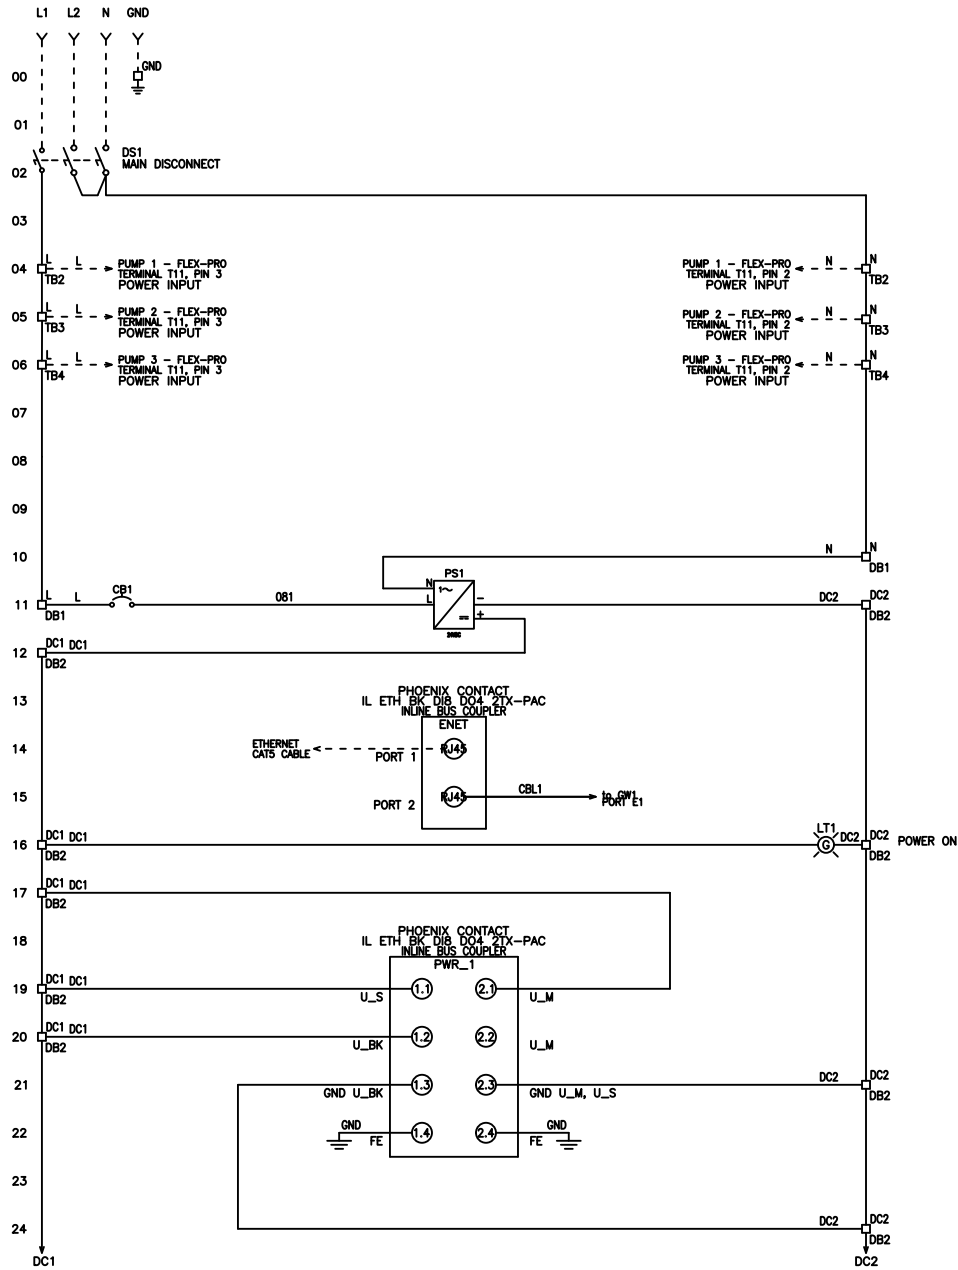

DASHED LINE INDICATES
FIELD WIRING.

USE COPPER CONDUCTORS ONLY.
TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).
BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE
INSTALLER: MUST BE SIZED ACCORDING TO PUMP/MOTOR
MANUFACTURING SPECIFICATIONS.
VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER
INSTALLATION IS COMPLETE.

DRAWN BY:	DATE:			
APPROVED BY:	DATE:			
THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.		TITLE: CP1377-A TRIPLEX CONTROL SCHEMATIC		
SIZE B	DWG NO. 759	PART NO. CP1377-A		REV E
SCALE NONE		SHEET		1 OF 2



USE COPPER CONDUCTORS ONLY.

TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).

BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE
INSTALLER: MUST BE SIZED ACCORDING TO PUMP/MOTOR
MANUFACTURING SPECIFICATIONS.

VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER
INSTALLATION IS COMPLETE.

FIELD WIRING CONNECTIONS

