
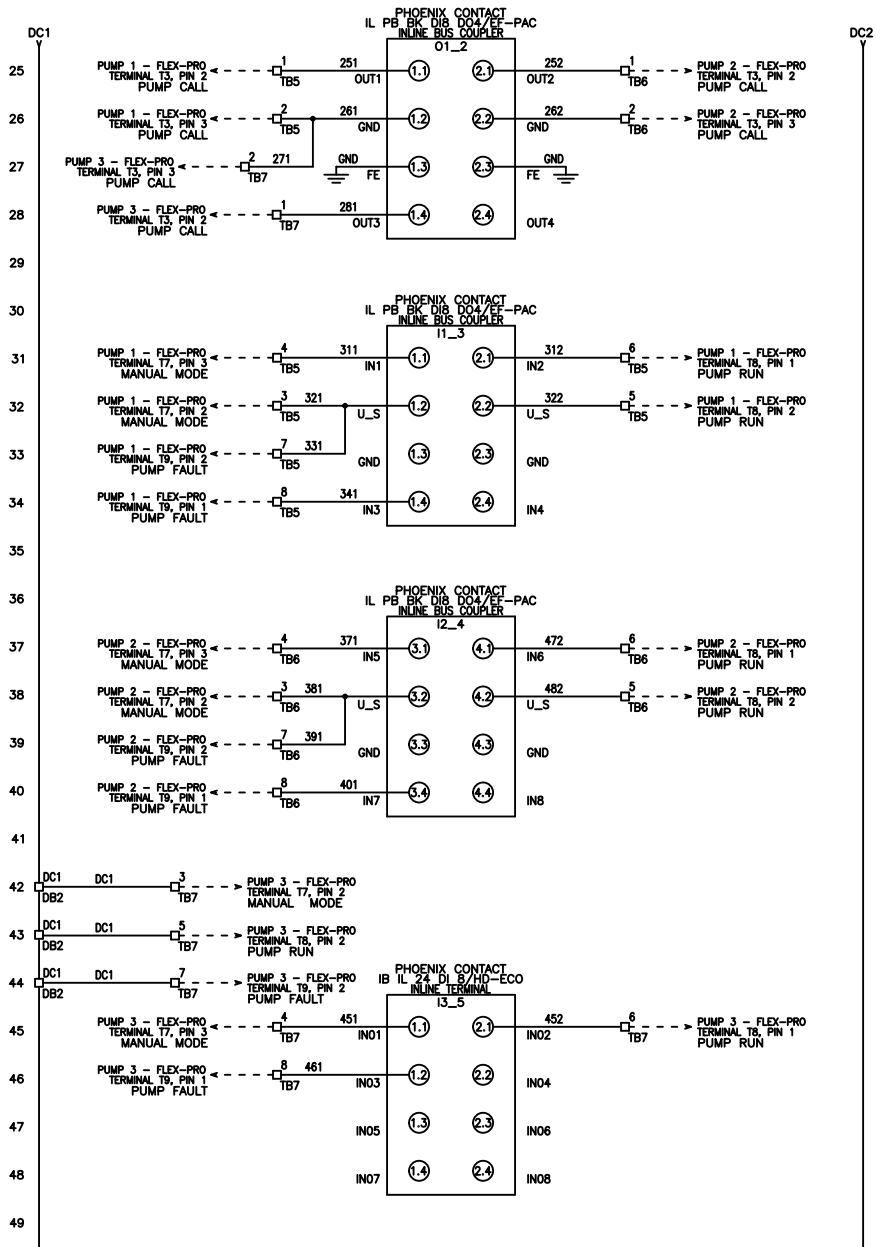


FNAME: CP1377-C

REVDATE: 0419

REVISIONS

ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	REMOVED TB1	2/05/19	
	B	UPDATED WIRING	2/19/19	
	C	UPDATED FIELD WIRING CONNECTION LABELS AND SUPPLY VOLTAGE	3/12/19	
	D	REVISED FELX-PRO T7 WIRING & LABEL	4/17/19	

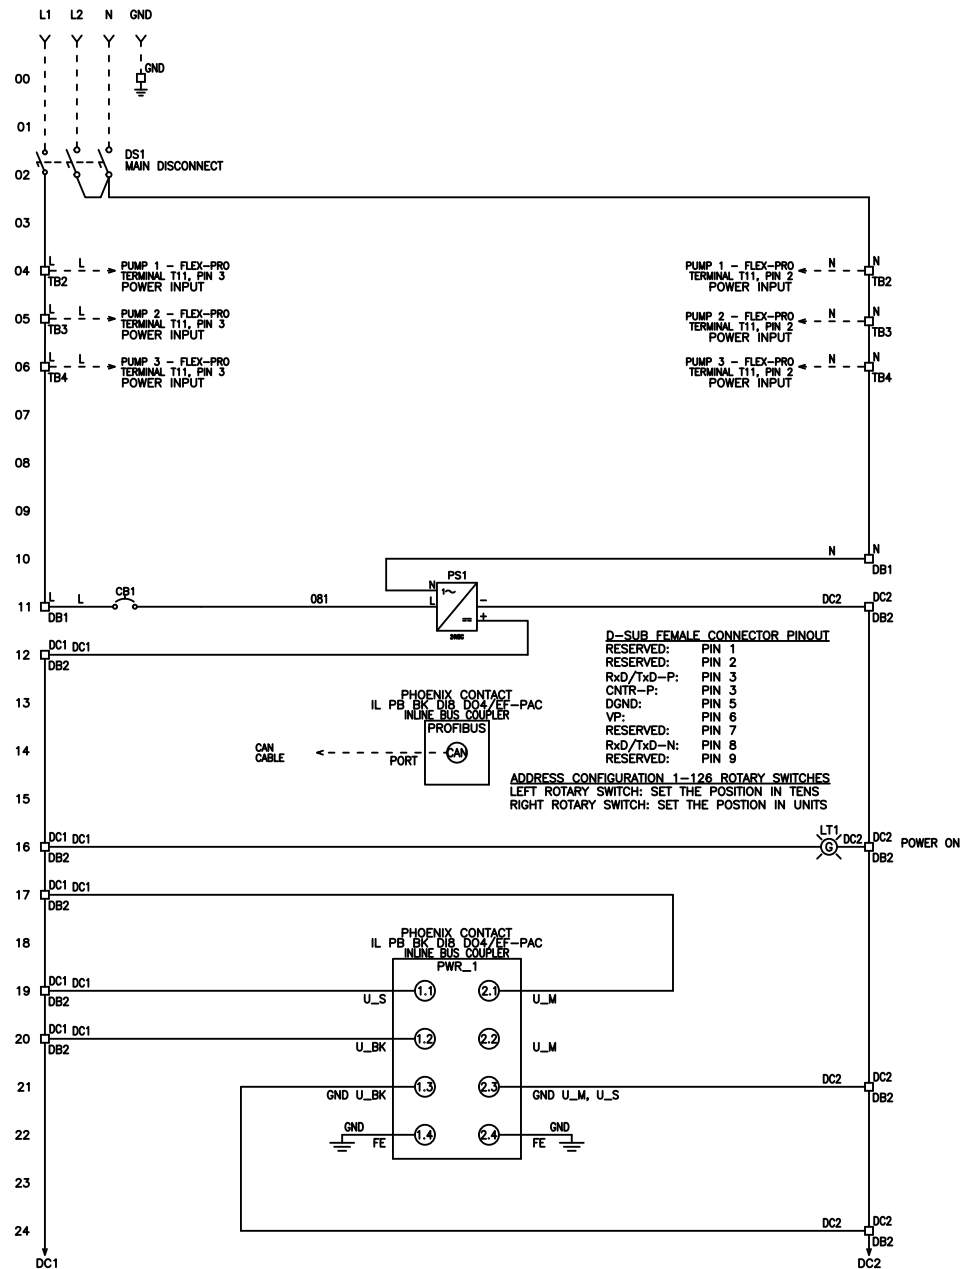

USE COPPER CONDUCTORS ONLY.

TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).

BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE INSTALLER: MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.

VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.

DRAWN BY: AO
DATE: 12/11/18
APPROVED BY: DATE:

THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.





TITLE: CP1377-C TRIPLEX CONTROL SCHEMATIC

SIZE	DWG NO.	PART NO.	REV
B	761	CP1377-C	D
SCALE	NONE	SHEET	1 OF 2




FNAME: CP1377-C

REVDATE: 0419

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	REMOVED TB1	2/05/19	
	B	UPDATED WIRING	2/19/19	
	C	UPDATED FIELD WIRING CONNECTION LABELS AND SUPPLY VOLTAGE	3/12/19	
	D	REVISED FELX-PRO T7 WIRING & LABEL	4/17/19	



FIELD WIRING CONNECTIONS

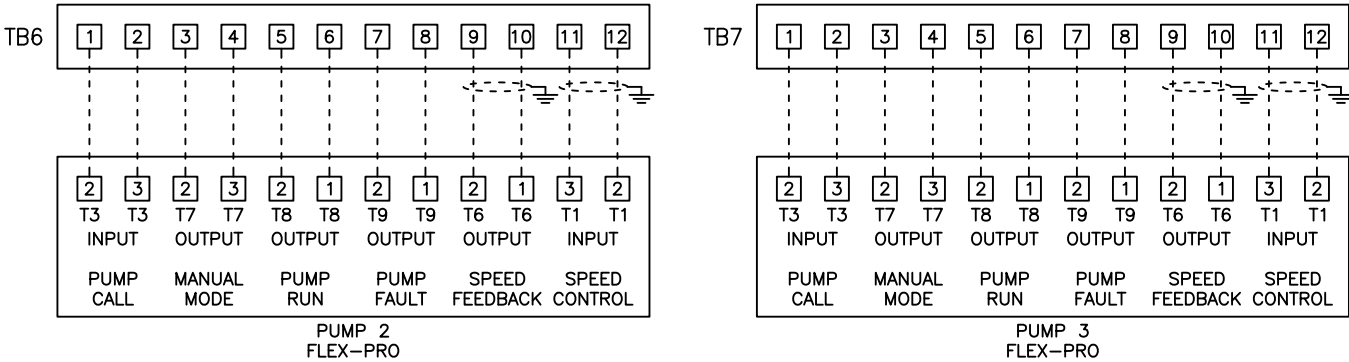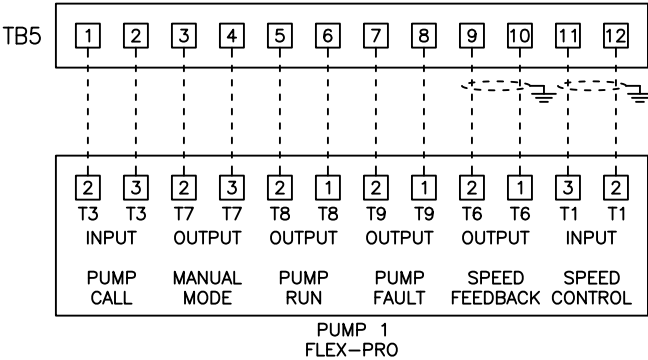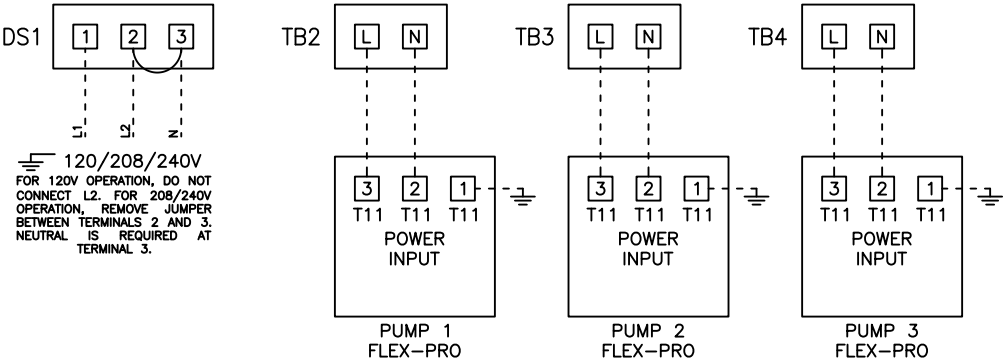


DASHED LINE INDICATES
FIELD WIRING.

USE COPPER CONDUCTORS ONLY.

TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).

BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE
INSTALLER: MUST BE SIZED ACCORDING TO PUMP/MOTOR
MANUFACTURING SPECIFICATIONS.

VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER
INSTALLATION IS COMPLETE.

DRAWN BY:		DATE:			
AO 12/11/18					
APPROVED BY:		DATE:		TITLE: CP1377-C TRIPLEX CONTROL SCHEMATIC	
THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.					
		SIZE B	DWG NO. 761	PART NO. CP1377-C	REV D
		SCALE NONE		SHEET 2	OF 2